



DEPARTMENT OF THE NAVY
U. S. NAVAL SUPPORT ACTIVITY NAPLES ITALY
PSC 817 BOX 1
FPO AE 09622-0001

6260
Ser. N00/1697
28 DEC 2021

From: Commanding Officer, U.S. Naval Support Activity, Naples, Italy
To: Parents and Staff, Support Site Middle and High Schools, U.S. Naval Support Activity, Naples, Italy

Subj: U.S. NAVAL SUPPORT ACTIVITY, NAPLES, ITALY SUPPORT SITE MIDDLE AND HIGH SCHOOL DRINKING WATER

Encl: (1) Overview of Results & Actions
(2) Support Site Middle/High School Complete Test Results
(3) Floor Plan of the Support Site Middle/High School

1. The safety and health of the children and staff at our Child Development Centers (CDC), schools, and Youth-Teen Centers (YTC) is my top priority. In my earlier letter announcing our lead in drinking water testing program, I told you we are testing all water outlets that could potentially be used for cooking, washing, or drinking at our CDCs, schools, and YTCs.

2. We received the results of recent water testing of 117 Middle/High School drinking water outlets. Of these, three outlets tested higher than Navy screening level of 15 parts per billion (ppb) for lead, which is the level requiring action to include additional testing and corrective measures. Lead in drinking water typically comes from the existing plumbing inside buildings including service lines, fittings, solder, water coolers, or water faucets. Lead is more likely to be found in drinking water when the water has not been run for an extended period of time and has been sitting in the system (e.g., overnight, weekends, etc.).

3. The lead levels were higher than the screening level at sinks in rooms 104 (two outlets), and 125. After receiving the test results, we immediately took these water outlets out of service. Details on the corrective actions we plan to take to reduce the amount of lead in water at these fixtures are discussed in enclosure (1). Enclosure (2) indicates the location of the fixtures that had lead levels higher than the screening level.

4. Here are some additional resources you may find informative:


a. EPA (lead in drinking water in schools and day care centers):
<https://www.epa.gov/dwreginfo/lead-drinking-water-schools-and-child-care-facilities>

b. Annual water quality report for the installation:
https://www.cnrc.navy.mil/regions/cnrcnaurafcent/installations/nsa_naples/om/environmental_support/drinking_water_consumer_confidence_report.html

5. If you have any health questions or concerns, I encourage you to set up a Virtual Visit with your health care provider through TRICARE Online or call the U.S. Naval Hospital, Naples,

Italy main appointment line (629-6000, or 081-11-6000). Virtual visits afford the time required for you to address particular concerns with your primary care provider.

6. Rest assured that my team and I will continue to monitor, test water quality, and take actions where necessary at the Middle/High School to ensure our drinking water lead levels are lower than screening levels. I am committed to the safety and health of all personnel and family members using our facilities and will keep you updated on this issue.

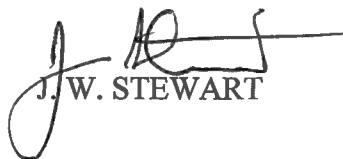

J. W. STEWART

Copy to:
CNIC N45
NAVFAC N45

Overview of Testing Results for Lead in Drinking Water and Corrective Actions for NSA Naples Support Site Middle/High School (Building 2058)

The Navy is committed to maintaining safe drinking water on its installations. The Acqua Campania aqueduct water supplied to the Navy and the Navy's water distribution system is regularly tested and in compliance with the Safe Drinking Water Act. Because lead exposure is a particular concern for children, and lead may be added to drinking water due to its presence in pipes, fittings, solder, and fixtures inside a building, the Navy policy requires that we test the lead content of drinking water in priority areas such as Youth-Teen Centers (YTCs), Schools, and Child Development Centers (CDCs) every five years.

Navy environmental personnel conducted lead testing at the NSA Naples Support Site Middle/High School in accordance with Navy and EPA guidelines. Samples from various locations in the Middle/High School were sent to the U.S. Army Public Health Center certified laboratory for analysis.

At the NSA Naples Support Site Middle/High School, outlets used for drinking and washing were tested. Out of 117 samples collected, 3 water outlets initially tested above the Navy screening level of 15 parts per billion (ppb) for lead in drinking water in schools and CDCs.

The three outlets that exceeded the screening level of 15 ppb were student lab and bathroom sinks located in rooms 104 (two outlets) and 125, which tested at 30 ppb, 16 ppb and 16 ppb, respectively. Since follow-up testing indicated that the elevated levels of lead appeared to be caused by the components of the water faucets, these water faucets were secured rendering them unusable. New faucets will be installed and additional follow-up testing will be conducted to verify that the new faucets are below the screening level of 15 ppb.

A copy of all test results is enclosed for your information. The test results are presented in two tables:

- Table 1 **Summary of Results** summarizes the data by category of use (e.g., drinking, cooking, and washing).
- Table 2 **Summary Statistics** summarizes all the data.

A floor plan of the NSA Naples Support Site Middle/High School has also been included to show the locations for the fixtures that exceeded 15 ppb.

Table 1 provides a description of each sampling location using three columns; *Category*, *Sampling ID*, and *Outlet Description*. The *Category* column gives information about whether the outlet is used for drinking water (water fountain), cooking (food preparation), or washing (primarily hand-washing or brushing teeth). The *Sample ID* column is the identification used to label each sample bottle. The *Outlet Description* column contains additional information to describe the outlet sampled under each category.

The next set of columns in **Table 1** provide *Initial Sampling Results*, and for those locations that exceeded the recommended screening level of 15 ppb the *Re-sampling Results*.

EPA sampling protocol requires water to not be used for between 8 and 18 hours prior to first draw sampling. Therefore, *Initial Sampling Results* were from first draw samples collected early in the morning before the Middle/High School opened and before any water was used. The *Initial Sampling Results* also indicate whether resampling is required and the date that fixtures greater than 15 ppb were secured. Outlets that exceeded 15 ppb are highlighted in yellow.

The *Re-sampling Results* section includes columns for *First Draw* and *Follow up Flushing* samples which help determine the source of lead. For cooking and washing outlets, aerators were removed and cleaned before retesting:

- If the lead concentration of both the *First Draw* and the 30 second flush sample resulted in lower than 15 ppb lead, the aerators were the source of lead and the outlet can be used for drinking if the aerators are cleaned on a regular basis. None of the outlets tested fit in this category.
- If the lead concentration of the resampled *First Draw* (but not the follow up 30 second flush) was greater than 15 ppb, the fixture was the source of lead. These fixtures can be used if water is flushed for 30 seconds before first use of the day or if the fixtures are replaced and retesting confirms that the new fixtures do not leach lead. The sinks in rooms 104 and 125 fit in this category. The faucets for these sinks will be replaced, and additional follow-up testing will be conducted to verify that the new fountains are below the screening level of 15 ppb.
- If the lead concentration of the sample following the 30 second flush was greater than 15 ppb and greater than the lead concentration of the first draw resample, the source of lead is the plumbing upstream of the outlet. These outlets should be disconnected/removed from service unless upstream plumbing is replaced. None of the outlets tested fit in this category.

The *Corrective Actions* column describes actions that are being implemented to remediate the source of lead. In the event that fixtures or upstream piping are replaced (e.g. faucets in rooms 104 and 125), there are columns for additional follow-up testing data. This testing will be conducted once the fixtures are replaced to confirm that the corrective actions are successful in reducing lead below 15 ppb.

To learn more about lead in drinking water in schools and day care centers visit the following EPA website: <https://www.epa.gov/dwreginfo/lead-drinking-water-schools-and-child-care-facilities>.

To learn more about the installation's public water supplier, see their annual water quality report: Region-specific links
https://www.cnic.navy.mil/regions/cnreurafcnt/installations/nsa_naples/om/environmental_support/drinking_water_consumer_confidence_report.html

To answer any questions you may have on the sampling program contact the NSA Naples Public Affairs Officer at pao_naples@eu.navy.mil. If you have any health questions or concerns, I encourage you to set up a Virtual Visit with your health care provider through TRICARE Online or call the hospital's main appointment line (629-6000, or 081-11-6000). Virtual Visits afford the time required for you to address particular concerns with your primary care provider.

Summary Results Table
Priority Areas Lead Testing and Corrective Actions (2021)
NSA NAPLES Support Site High School
Bldg. 2058

Table 1. Summary of Results

SAMPLING LOCATION DESCRIPTION				INITIAL SAMPLING RESULTS			RE-SAMPLING RESULTS			CORRECTIVE ACTIONS	POST-CORRECTIVE ACTION SAMPLING RESULTS	
CATEGORY [Water's intended use]	SAMPLE ID [Use same nomenclature as baseline sample event]	Outlet Description [At a minimum, room number and type of outlet; include filter identification and whether a motion sensor faucet or blended water, as applicable]	Comments [Provide, for example, whether filter was removed, staining was present, any identifying marks]	Lead Screening Level of 15 ppb			Lead Screening Level of 15 ppb			Description [Enter brief description of remediation activities; for example, replace fixture, add a point of use device, check grounding wires, replace lead piping, reconfigure piping, permanently close outlet, implement aerator maintenance program]	Recommended Level = 15 ppb	
				First Draw (ppb) [numeric value]	Retest required? [YES or NO]	Date Fixture Secured? (See Note 1) [N/A if First Draw is ≤ 15ppb; otherwise mm/dd/yyyy]	Water Fountain/Chiller 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb) [numeric value]	First Draw (ppb) [numeric value]	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb) [numeric value]		First Draw (ppb) [numeric value]	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb) [numeric value]
SAMPLING DATE RESULTS DATE				3/13/2021			mm/dd/yyyy	7/1/2021	7/1/2021			
				05/20-24/2021			mm/dd/yyyy	7/23/2021	7/23/2021			
DRINKING	SS-HIG-LP-001	102 Kitchen sink		6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-002	103 Kitchen sink A		2.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-003	103 Kitchen sink B		2	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-004	103 Kitchen sink C		1.7	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-005	103 Kitchen sink D		4.5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-006	103 Kitchen sink E		1.8	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-007	104 Kitchen sink A		1.9	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-008	104 Kitchen sink B		3.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-009	104 Kitchen sink C		3.3	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-010	104 Kitchen sink D		3.4	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-011	104 Kitchen sink E		2.2	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-012	104 Kitchen sink F		30	YES	6/7/2021	N/A	25	2.8	Replace fixture	N/A	N/A
DRINKING	SS-HIG-LP-013	104 Kitchen sink G		16	YES	6/7/2021	N/A	340	4.5	Replace fixture	N/A	N/A
DRINKING	SS-HIG-LP-014	105 Kitchen sink A		2.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-015	105 Kitchen sink B		3.1	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-016	105 Kitchen sink C		4.1	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-017	105 Kitchen sink D		4.4	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-018	105 Kitchen sink E		3.3	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-019	106 Kitchen sink A		2.3	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-020	106 Kitchen sink B		4.8	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-021	106 Kitchen sink C		4	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-022	106 Kitchen sink D		3.4	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-023	106 Kitchen sink E		3	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-024	106 Kitchen sink G		4	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-025	106 Kitchen sink H		11	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-026	107 Kitchen sink A		2.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-027	107 Kitchen sink B		3.5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-028	107 Kitchen sink C		3.7	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-029	107 Kitchen sink D		2.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-030	107 Kitchen sink E		3.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-031	108A Nurse kitchen sink		14	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-035	110 Water fountain bubbler A (Rm 113A)		5.9	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-036	110 Water fountain bubbler B (Rm 115)		4.5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-037	110 Water fountain bubbler C (Rm 115)		2.3	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-038	113A Kitchen sink		6.5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-039	126 Kitchen sink A		13	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-040	126 Kitchen sink B		15	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-041	126 Kitchen sink C		9.8	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-042	126 Kitchen sink D		8.9	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-056	122a (was 122B) Kitchen sink		4.5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-058	111 Kitchen sink		6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-067	110 Water fountain bubbler A (Rm 125)		14	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-068	110 Water fountain bubbler B (Rm 125)		4	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-069	226 Water fountain bubbler A (Rm 207-T201)		6.8	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-071	110 Water fountain bubbler C		5.7	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-072	110 Water fountain bubbler D		5.9	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-073	110 Water fountain bubbler E		7.2	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-074	110 Water fountain bubbler F (Rm 228-229)		9.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-091	234A Kitchen sink		7.1	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-092	209A Kitchen sink		4.4	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-106	209 Kitchen sink		5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-107	118 Water fountain bubbler A (Rm 115)		3.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-108	118B Water fountain bubbler B (Rm 115)		2.3	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-114	107 Kitchen sink E(2)		1.8	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-115	107 Kitchen sink F		7.7	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-116	105 Kitchen sink F		5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-117	105 Kitchen sink G		6.2	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-121	Water fountain bubbler (Rm 122)		5.2	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-122	103 Kitchen sink F		4.2	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
DRINKING	SS-HIG-LP-123	103 Kitchen sink G		1.5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
COOKING	SS-HIG-LP-043	125 Kitchen sink A		2.8	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
COOKING	SS-HIG-LP-044	125 Kitchen sink B		4.2	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
COOKING	SS-HIG-LP-045	125 Kitchen sink C		3.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-032	108 Nurse high hand washing A		6.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-033	108 Nurse high hand washing B		10	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-034	108H Nurse Handicap bathroom		2.7	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A

Summary Results Table
 Priority Areas Lead Testing and Corrective Actions (2021)
 NSA NAPLES Support Site High School
 Bldg. 2058

SAMPLING LOCATION DESCRIPTION				INITIAL SAMPLING RESULTS Lead Screening Level of 15 ppb			RE-SAMPLING RESULTS Lead Screening Level of 15 ppb			CORRECTIVE ACTIONS	POST-CORRECTIVE ACTION SAMPLING RESULTS Recommended Level = 15 ppb	
CATEGORY [Water's intended use]	SAMPLE ID [Use same nomenclature as baseline sample event]	Outlet Description [At a minimum, room number and type of outlet; include filter identification and whether a motion sensor faucet or blended water, as applicable]	Comments [Provide, for example, whether filter was removed, staining was present, any identifying marks]	First Draw (ppb) [numeric value]	Retest required? [YES or NO]	Date Fixture Secured? (See Note 1) [N/A if First Draw is ≤ 15ppb; otherwise mm/dd/yyyy]	Water Fountain/Chiller 15 min. Follow up Flush Sample - Collected day before First Draw Sampling (ppb) [numeric value]	First Draw (ppb) [numeric value]	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb) [numeric value]	Description [Enter brief description of remediation activities; for example, replace fixture, add a point of use device, check grounding wires, replace lead piping, reconfigure piping, permanently close outlet, implement aerator maintenance program]	First Draw (ppb) (See note 2) [numeric value]	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb) [numeric value]
SAMPLING DATE				3/13/2021			mm/dd/yyyy	7/1/2021	7/1/2021		mm/dd/yyyy	
RESULTS DATE				05/20-24/2021			mm/dd/yyyy	7/23/2021	7/23/2021		mm/dd/yyyy	
WASHING	SS-HIG-LP-046	125 High hand washing		16	YES	6/7/2021	N/A	20	0	Replace fixture	N/A	N/A
WASHING	SS-HIG-LP-047	T101 (was 110A) Bathroom high hand washing A		4	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-048	T101 (was 110A) Bathroom high hand washing E		3.3	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-049	T101 (was 110A) Bathroom high hand washing C		3.7	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-050	T101 (was 110A) Bathroom high hand washing D		3.7	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-051	T102 (was 110B) Bathroom high hand washing A		4.8	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-052	T102 (was 110B) Bathroom high hand washing E		4.7	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-053	T102 (was 110B) Bathroom high hand washing C		4.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-054	T102 (was 110B) Bathroom high hand washing D		5.5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-055	T102 (was 110B) Bathroom high hand washing F		3.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-057	T122E (was 122H) Bathroom high hand washing		7.5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-059	117 Bathroom high hand washing A		3.9	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-060	117 Bathroom high hand washing B		4.5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-061	117 Bathroom high hand washing C		5.9	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-062	117 Handicap bathroom		4.2	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-063	120C (was 119A) Bathroom high hand washing A		6.5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-064	120C (was 119A) Bathroom high hand washing B		5.4	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-065	120C (was 119A) Bathroom high hand washing C		5.5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-066	120D (was 119A) Handicap bathroom		5.5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-075	T202 (was 208BH) Bathroom high hand washing A		4.3	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-076	T202 (was 208BH) Bathroom high hand washing B		3.7	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-077	T202 (was 208BH) Bathroom high hand washing C		3.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-078	T202 (was 208BH) Bathroom high hand washing D		5.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-079	T202 (was 208BH) Bathroom high hand washing E		4.4	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-080	T202 (was 208BH) Bathroom high hand washing F		5.1	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-081	T202 (was 208BH) Bathroom high hand washing G		3.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-083	T203 (was 208AH) Bathroom high hand washing A		4.9	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-084	T203 (was 208AH) Bathroom high hand washing B		4.1	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-085	T203 (was 208AH) Bathroom high hand washing C		3.4	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-086	T203 (was 208AH) Bathroom high hand washing D		4.2	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-087	T203 (was 208AH) Bathroom high hand washing E		3.2	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-088	T203 (was 208AH) Bathroom high hand washing F		3.9	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-089	T203 (was 208AH) Bathroom high hand washing G		3.8	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-093	T205 (was 215A) Bathroom high hand washing A		5.2	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-094	T205 (was 215A) Bathroom high hand washing E		4.8	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-095	T205 (was 215A) Bathroom high hand washing C		6.1	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-096	T205 (was 215A) Bathroom high hand washing D		2.3	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-097	T205 (was 215A) Bathroom high hand washing F		1.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-098	T206 (was 215E) Handicap bathroom		2.9	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-099	T207 (was 215B) Bathroom high hand washing A		4.4	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-100	T207 (was 215B) Bathroom high hand washing E		4.3	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-101	T207 (was 215B) Bathroom high hand washing C		3.6	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-102	T207 (was 215B) Bathroom high hand washing D		4.2	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-103	T208 (was 215C) Handicap bathroom		3.5	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-109	116/117 (116A 116E) Bathroom high hand washing		6.1	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-110	120A-E Bathroom high hand washing		4.7	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-111	101 Handicap bathroom		2.2	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-112	110dH Handicap bathroom		3.1	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-113	110cH Handicap bathroom		7.1	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-119	T202 Handicap bathroom		5.3	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A
WASHING	SS-HIG-LP-120	T203 Handicap bathroom		5.1	NO	N/A	N/A	N/A	N/A	Routine Control Measures Only	N/A	N/A

Notes:
¹ Affected outlets were immediately secured after receiving verbal communication from the lab on results exceeding the recommended level of 15 ppb.
² Post-remediation sampling will be conducted once the fixtures are replaced to confirm that the corrective actions are successful in reducing lead below 15 ppb.

Table 2. Summary Statistics

CATEGORY	INITIAL SAMPLING RESULTS	RE-SAMPLING RESULTS			POST-CORRECTIVE ACTION RESULTS
	Lead Screening Level of 15 ppb				
	First Draw (ppb)	Water Fountain	First Draw (ppb)	Follow up Flush	First Draw (ppb)
Total Drinking	60	N/A	2	2	N/A
Total Drinking > 15 ppb	2	N/A	2	0	N/A
Total Cook	3	N/A	0	0	N/A
Total Cook > 15 ppb	0	N/A	0	0	N/A
Total Washing	54	N/A	1	1	N/A
Total Washing > 15 ppb	1	N/A	1	0	N/A
Total Samples	117	N/A	3	3	N/A
Total Samples > 15 ppb	3	N/A	3	0	N/A


Bldg.# 2058

Fac. Name: **HIGH SCHOOL**

Floor: *Ground*

**NSA NAPLES 2021 STEP 2
DRINKING WATER SAMPLING
FOR LEAD IN PRIORITY
AREAS**

**SUPPORT SITE HIGH SCHOOL
BLDG. 2058
GROUND FLOOR**

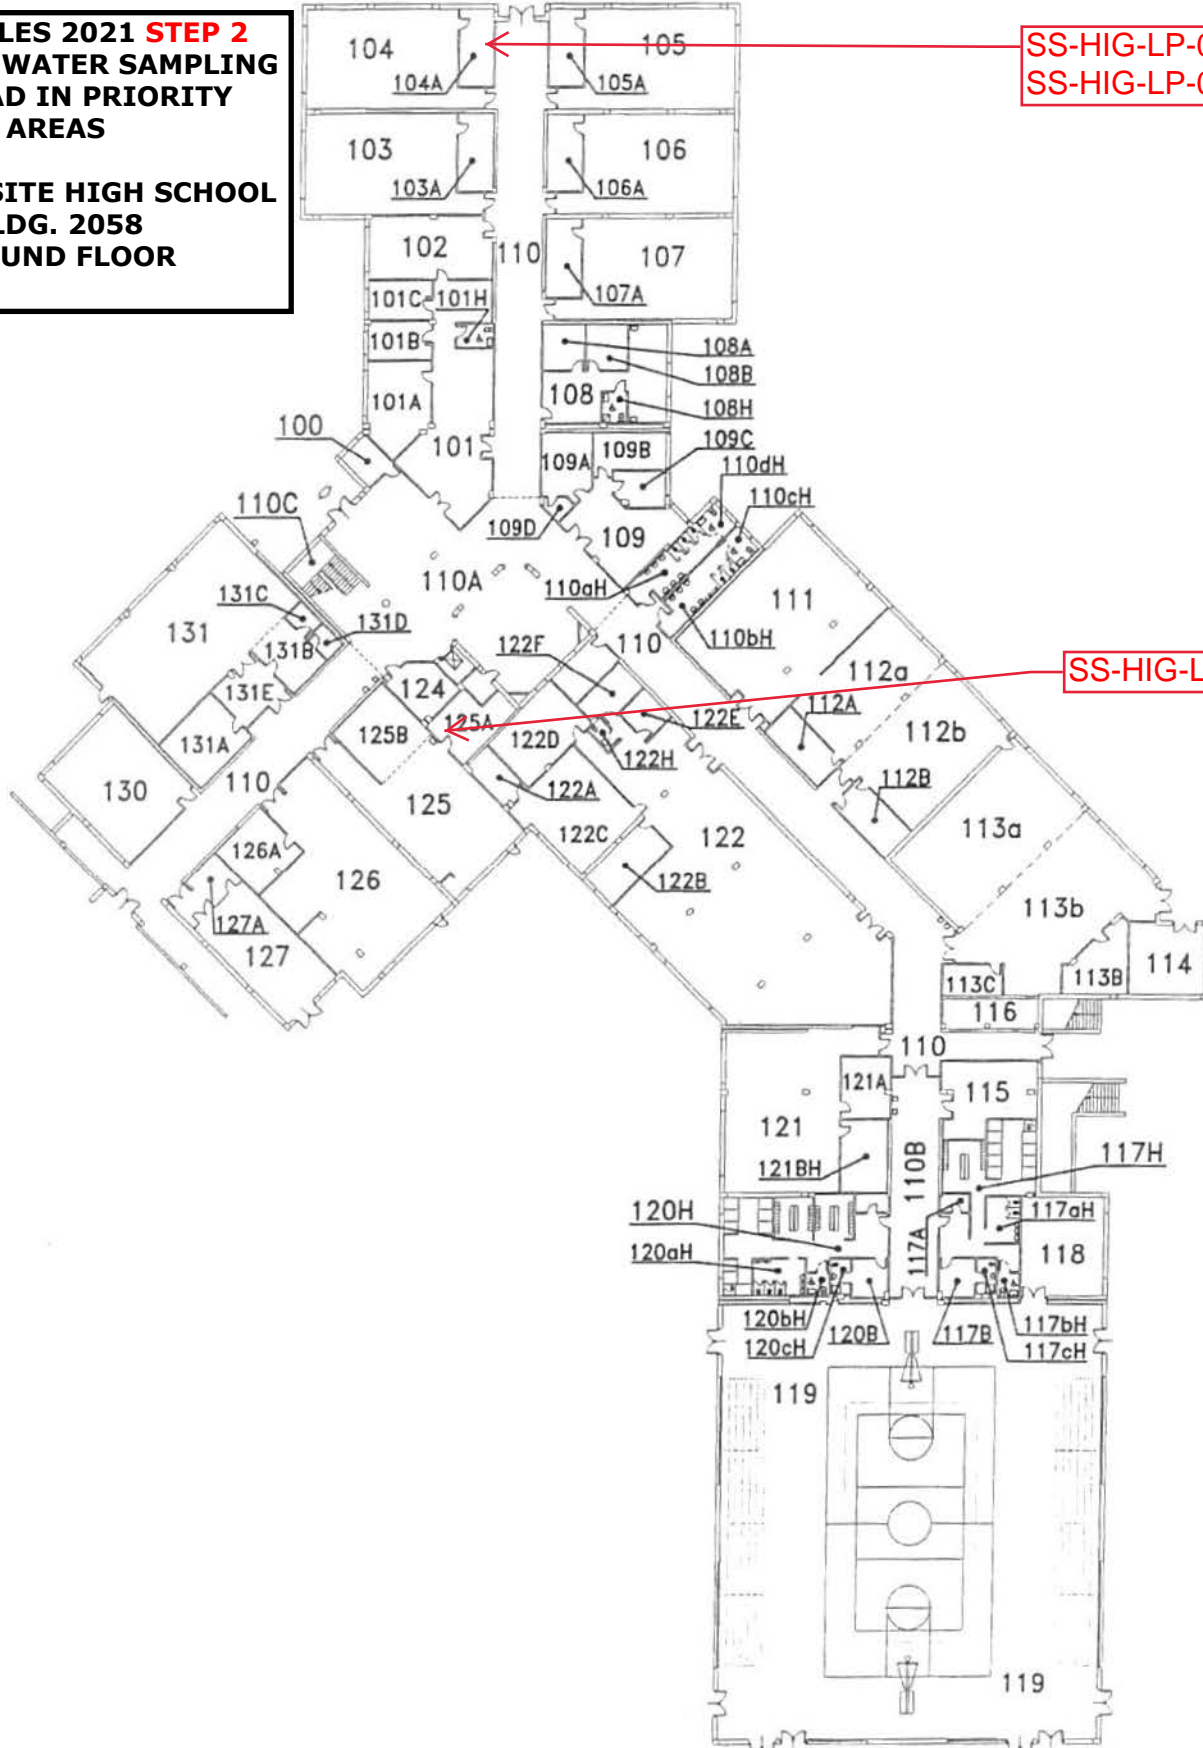

SS-HIG-LP-012
SS-HIG-LP-013

SS-HIG-LP-046

Bldg.# 2058

Fac. Name: **HIGH SCHOOL**

Floor: 1st

**NSA NAPLES 2021 STEP 2
DRINKING WATER SAMPLING
FOR LEAD IN PRIORITY
AREAS**

**SUPPORT SITE HIGH SCHOOL
BLDG. 2058
FIRST FLOOR**

